



ETA-Danmark A/S  
Göteborg Plads 1  
DK-2150 Nordhavn  
Tel. +45 72 24 59 00  
Fax +45 72 24 59 04  
Internet [www.etadanmark.dk](http://www.etadanmark.dk)

Authorized and notified according  
to Article 29 of the Regulation (EU)  
No 305/2011 of the European  
Parliament and of the Council of 9  
March 2011

MEMBER OF EOTA



## European Technical Assessment ETA-15/0869 of 12/01-2016

### General Part

#### Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the  
construction product:

ROKU® System IWM III Plus

Product family to which the  
above construction product  
belongs:

Fire Stopping and Sealing with high performance  
intumescent material used in penetration seals.

Manufacturer:

Rolf Kuhn GmbH  
Jägersgrund 10  
57339 Erndtebrück / Germany  
Tel. + 49 2753 5945-0  
Fax +49 2753 5945-21  
Internet [www.kuhn-brandschutz.com](http://www.kuhn-brandschutz.com)

Manufacturing plant:

Rolf Kuhn GmbH  
Jägersgrund 10  
57339 Erndtebrück / Germany

This European Technical  
Assessment contains:

29 pages including 9 annexes which form an integral  
part of the document

This European Technical  
Assessment is issued in  
accordance with Regulation  
(EU) No 305/2011, on the  
basis of:

Guideline for European technical approval of "Fire  
Stopping and Fire Sealing Products", ETAG 026 Part 2:  
"Penetration Seals", used as European Assessment  
Document (EAD) according to Article 66 Paragraph 3 of  
Regulation (EU) No 305/2011.

This version replaces:

-

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex (es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such

## II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

### 1 Technical description of product and intended use

#### Technical description of the product

The ROKU® System IWM III plus consists of the high performance intumescent material „ROKU® Strip“ according to the ETA – 10/0117, with a width of 50 mm and a thickness of 2 mm, which is wrapped in one or more layers around the pipe or the insulation. The ROKU® System IWM III plus is installed in openings in fire classified walls or floors around pipes through walls made from concrete, aerated concrete, masonry, light weight partition structures, shaft wall constructions or concrete floors. The system must be inserted into the annular gap flush with the surface. In the event of a fire, the intumescent material expands with high pressure and thus seals the opening hermetically against flames and smoke. The required thickness of the wrap depending on the fire resistance and pipe diameter is established by the number of wrap layers.

#### Specification of the intended use in accordance with the applicable European Assessment Document

The construction products The ROKU® System IWM III plus with “ROKU® Strip“, is intended for use as components with a fire protection effect in walls made from concrete, aerated concrete, masonry, light weight partition, shaft wall constructions or concrete floors structures that are subject to requirements related to fire protection. Their fire resistant capability prevents heat transmission and fire spreading in the event of fire. See annex 1 for a detailed specification of the intended use.

Table 1 – components of the verified penetration seals

Product type	Trade name
Flexible intumescent strip with a nominal thickness of 2 mm and a width of 50 mm	ROKU® Strip
Mineral wool board “Hardrock 040” or “Hardrock II” pre-coated with 0,5 mm ( dry layer thickness ) ROKU® MFC airless on the visible surface. minimum apparent density of 150 kg/m <sup>3</sup> and a melting point ≥ 1000 <sup>0</sup> C, thickness ≥ 50 mm	ROKU® MFP
Ablative fire stop coating	ROKU® MFC airless or TV
<b>Insulations</b>	
Closed cell flexible polyethylene foam insulation in form of tubes, thickness ≤ 4 mm, density ≥ 30 kg /m <sup>3</sup> ≤ 40 kg / m <sup>3</sup>	Thermafex Thermacompact TF or equal products
Closed cell, flexible elastomeric	Armacell

foam ( FEF ) insulation in form of tubes, thickness 7 mm – 31,5 mm, tolerances + - 2,5 mm	Armaflex AF or equal products
---	-------------------------------

Detailed information and data on the verified penetration seals are given in Annexes 1 to 9

The performances given in Section 3 exclusively relate to this penetration seals (e.g. with respect to the design and arrangement of the components of the penetration seals and the type and position of the services).

The verification and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of at least 10 years for The ROKU® System IWM III plus.

The indications given on the working life cannot be interpreted as a guarantee given by the manufacturer, but are to be regarded only as a means for choosing the right product in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

Characteristic	Assessment of characteristic										
<b>3.2 Safety in case of fire (BWR 2)</b>											
Reaction to fire	The components of ROKU® System IWM III plus and its detail products has been tested or classified for reaction to fire, in accordance with EN 13501-1										
	<table border="1"> <thead> <tr> <th>components</th> <th>Class according to 13501 - 1</th> </tr> </thead> <tbody> <tr> <td>ROKU® Strip</td> <td>E</td> </tr> <tr> <td>ROKU® MFC airless or TV</td> <td>E</td> </tr> <tr> <td>ROKU® MFP</td> <td>F</td> </tr> <tr> <td>Mineral fibre panel with a nominal density of 150 kg / m<sup>3</sup></td> <td>A1</td> </tr> </tbody> </table>	components	Class according to 13501 - 1	ROKU® Strip	E	ROKU® MFC airless or TV	E	ROKU® MFP	F	Mineral fibre panel with a nominal density of 150 kg / m <sup>3</sup>	A1
components	Class according to 13501 - 1										
ROKU® Strip	E										
ROKU® MFC airless or TV	E										
ROKU® MFP	F										
Mineral fibre panel with a nominal density of 150 kg / m <sup>3</sup>	A1										
Resistance to fire	<p>The ROKU® System IWM III plus used in penetrations seals as described in annex 1-9 in at least 100 mm thick walls made from concrete, aerated concrete, masonry or light weight partition or shaft wall constructions structures is classified as <b>EI 60-120</b> in accordance with EN 13501-2</p> <p>The ROKU® System IWM III plus used in penetrations seals as described in annex 1-9 in at least 150 mm thick slabs made from concrete is classified as <b>EI 60-240</b> in accordance with EN 13501-2</p>										
<b>3.3 Hygiene, health and the environment (BWR 3)</b>											
Influence on air quality	The product does not contain/release dangerous substances specified in TR 034, dated March 2012										
<b>3.7 Sustainable use of natural resources (BWR 7)</b>											
	No Performance Determined										

\*) See additional information in section 3.9 – 3.12.

In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

### 3.9 General aspects

The verification of durability is part of testing the essential characteristics. The ROKU® System IWM III plus with mineral fibre panels may be used in end-use applications according to the provisions for use category Y<sub>2</sub> and the ROKU® System IWM III plus without mineral fibre panels may be used in end-use applications according to the provisions for use category X without expecting significant changes of the characteristics relevant for fire protection.

Products that meet the requirements for type Y<sub>2</sub> also meet the requirements for type Z<sub>1</sub> and Z<sub>2</sub>

It is assumed that:

- damages to the penetration seal are repaired accordingly,
- the installation of the penetration seal does not effect the stability of the adjacent building element – even in case of fire,
- the installations are fixed to the adjacent building element in accordance with the relevant regulations in such a way that, in case of fire, no additional mechanical load is imposed to the penetration seal.
- The support of the installations is maintained for the required period of the fire resistance and
- Pneumatic dispatch systems, compressed air systems, etc. are switched off by additional means in case of fire.

This European Technical Assessment does not address any risks associated with the emission of dangerous liquids or gases caused by failure of pipes in case of fire nor does it prove the prevention of the transmission of fire through heat transfer via the medium in the pipes.

The risk of downward spread of fire caused by burning material which drips through a pipe to floors below, is not considered in this European Technical Assessment ( see EN 1366-3:2009, clause 1 )

The durability assessment does not make account of the possible effect on the penetration seal of substances permeating through the pipe walls.

The assessment does not cover the avoidance of the destruction of the penetration seal or of the adjacent building elements by forces caused by temperatures changes in case of fire. This has to be considered when designing the piping system.

The European technical Assessment is issued for the product on the basis of agreed data /information, deposited with the ETA-Danmark. Changes to the product or production process, which could result in this deposited data / information being incorrect, should be

notified to the ETA Danmark before the changes are introduced.

The ETA-Danmark will decide whether or not such changes affect the European Technical Assessment and if so whether further assessment or alterations to the European Technical Assessment, shall be necessary.

## **4 Assessment and verification of constancy of performance (AVCP)**


### **4.1 AVCP system**

According to the decision 1999/454/EC of the European Commission, as amended by 2001/596/EC, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is 1.

## **5 Technical details necessary for the implementation of the AVCP system, as foreseen in the applicable EAD**


Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking the product

Issued in Copenhagen on 2016-01-12 by

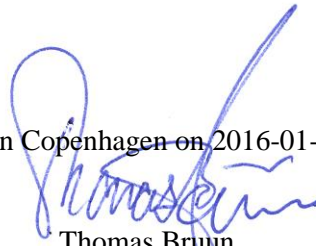

Thomas Bruun  
Managing Director, ETA-Danmark

**Annex 1**  
**Product details, definitions and specification of intended use**

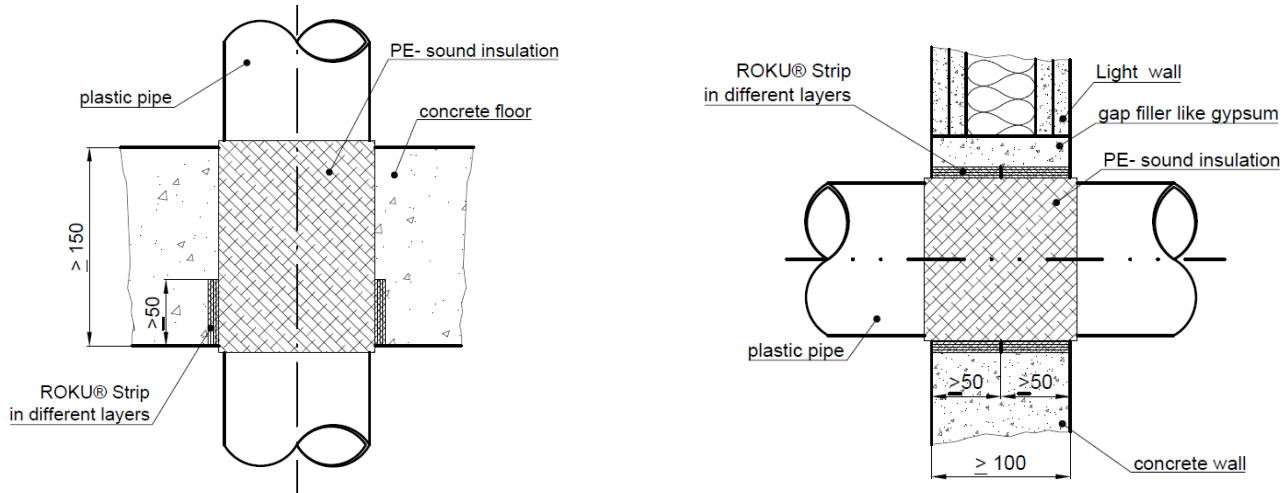

The ROKU® System IWM III plus

Product and performance of the The ROKU® System IWM III plus:

Manufacturer	Description	
Rolf Kuhn GmbH Jägersgrund 10 57339 Erndtebrück Germany	ROKU® Strip	
Property	Parameter	Method
Density	1200 kg/m <sup>3</sup> + - 10 %	
Content of non-volatile components	< 1 %	
Weight loss due to heating	49,0 to 63 %	( tested at 550 <sup>0</sup> C over 30 min
Dimensions	Thickness 1,0 - 8,0 mm, width 5 – 3200 mm	
Expansion ratio	18 – 38 ( nominal thickness 1,5 )	Tested at 550 <sup>0</sup> C for 30 min with a top load

Product and performance of the ROKU® MFC and MFP, see table 1

**Intended use:**

The pipe penetration seal “ROKU® System IWM III plus” is intended to be used to temporarily or permanently reinstate the fire resistance performance of flexible wall constructions, rigid wall constructions, shaft wall constructions and rigid floor constructions where they have been provided with apertures which are penetrated by various plastic pipes.

The pipe penetration seal “ROKU® System IWM III plus” can be installed only in the types of separating elements as specified in the following table.

<b>Separating element</b>	<b>Construction</b>
Flexible walls	<ul style="list-style-type: none"> <li>• Steel studs or timber studs lined on both faces with minimum 2 layer of boards ( minimum Thickness 12,5 mm )</li> <li>• For timber stud walls there shall be a minimum distance of 100 mm of penetration seal to any timber stud. The cavity between the penetration seal and the timber stud has to be closed with a minimum 100 mm of insulation with classification A1 or A2 according to EN 13501 – 1</li> <li>• Minimum density 550 kg/m<sup>3</sup></li> <li>• Minimum thickness 94 mm</li> <li>• Classification according to EN13501 – 2 : <math>\geq</math> EI 90</li> <li>• This European technical approval does not cover sandwich panel constructions and flexible walls were the lines does not cover studs on both sides. Penetrations in such constructions shall be tested on a case by case basis.</li> </ul>
Rigid walls	<ul style="list-style-type: none"> <li>• Aerated concrete, concrete, masonry</li> <li>• Minimum thickness 100 mm</li> <li>• The rigid wall shall be classified in accordance with EN 13501 – 2 for the required fire resistance period.</li> </ul>
Shaft walls	<ul style="list-style-type: none"> <li>• Steel studs lined on one face with minimum 2 layer of boards ( minimum Thickness 20 mm )</li> <li>• Minimum thickness 2 x 20 mm</li> <li>• Classification according to EN13501 – 2 : <math>\geq</math> EI 90</li> </ul>
Rigid floors	<ul style="list-style-type: none"> <li>• Aerated concrete, concrete, masonry</li> <li>• Minimum density 550 kg/m<sup>3</sup></li> <li>• Minimum thickness 150 mm</li> <li>• The rigid wall shall be classified in accordance with EN 13501 – 2 for the required fire resistance period.</li> </ul>

The Pipe penetration seal “ROKU® System IWM III plus” can only be configured as specified in the following tables. Other parts or service support constructions shall not penetrate the penetration seal.

<b>Penetrating element</b>	<b>Construction characteristics for installation of the penetrating element in flexible walls and rigid walls</b>
Plastic pipes	<ul style="list-style-type: none"> <li>• PVC – U pipes according to EN ISO 1452-1 or EN ISO 15493 and DIN 8061 / DIN 8062 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PE – HD pipes according to EN 1519 – 1 or EN ISO 15494 and DIN 8074 / DIN 8075 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PP pipes according to EN ISO 15494 and DIN 8077 / DIN 8078 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Wavin Si Tech pipes from manufacturer “ Wavin GmbH ” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Alpex F 50 Profi and Alpex L Pipes from manufacturer “ Fränkische Rohrwerke Geb. Kirchner GmbH &amp; Co KG” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Uponor MLC pipe white (old name Unipipe Mehrschichtverbundrohr) pipes from manufacturer “ Uponor GmbH” or equal product with diameters and wall thicknesses as defined the following annexes of the ETA</li> </ul>



	<ul style="list-style-type: none"> <li>• aquatherm green pipe MS ( old name Fusiotherm Stabiverbund ) pipes from manufacturer “ aquatherm GmbH” or equal product with diameters and wall thicknesses as defined the following annexes of the ETA</li> </ul>
--	---



<b>Penetrating element</b>	<b>Construction characteristics for installation of the penetrating element in mineral fibre sealants</b>
Plastic pipes	<ul style="list-style-type: none"> <li>• PVC – U pipes according to EN ISO 1452-1 or EN ISO 15493 and DIN 8061 / DIN 8062 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PE – HD pipes according to EN 1519 – 1 or EN ISO 15494 and DIN 8074 / DIN 8075 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PP pipes according to EN ISO 15494 and DIN 8077 / DIN 8078 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> </ul>

<b>Penetrating element</b>	<b>Construction characteristics for installation of the penetrating element in shaft wall constructions</b>
Plastic pipes	<ul style="list-style-type: none"> <li>• PVC – U pipes according to EN ISO 1452-1 or EN ISO 15493 and DIN 8061 / DIN 8062 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PE – HD pipes according to EN 1519 – 1 or EN ISO 15494 and DIN 8074 / DIN 8075 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PP pipes according to EN ISO 15494 and DIN 8077 / DIN 8078 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> </ul>



<b>Penetrating element</b>	<b>Construction characteristics for installation of the penetrating element in rigid floors</b>
Plastic pipes	<ul style="list-style-type: none"> <li>• PVC – U pipes according to EN ISO 1452-1 or EN ISO 15493 and DIN 8061 / DIN 8062 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PE – HD pipes according to EN 1519 – 1 or EN ISO 15494 and DIN 8074 / DIN 8075 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• PP pipes according to EN ISO 15494 and DIN 8077 / DIN 8078 with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Wavin Si Tech pipes from manufacturer “ Wavin GmbH ” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Geberit Silent PP pipes from manufacturer “ Geberit Vertriebs GmbH ” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Polokal NG pipes from manufacturer “ Poloplast GmbH &amp; Co KG ” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Rehau Raupiano pipes from manufacturer “ Rehau AG &amp; CO ” or equal product with diameters and wall thicknesses as defined in Annex .... of the ETA</li> <li>• Alpex F 50 Profi and Alpex L Pipes from manufacturer “ Fränkische Rohrwerke Geb. Kirchner GmbH &amp; Co KG” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Uponor MLC pipe white (old name Unipipe Mehrschichtverbundrohr) pipes from manufacturer “ Uponor GmbH” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> <li>• Aquatherm green pipe MS ( old name Fusiotherm Stabiverbundrohr ) pipes from manufacturer “ aquatherm GmbH” or equal product with diameters and wall thicknesses as defined in the following annexes of the ETA</li> </ul>

**Annex 2**  
**Detailed information for the confirmation of fire resistance**


Installation in lightweight partitions or in concrete walls with or without additional pipe insulation

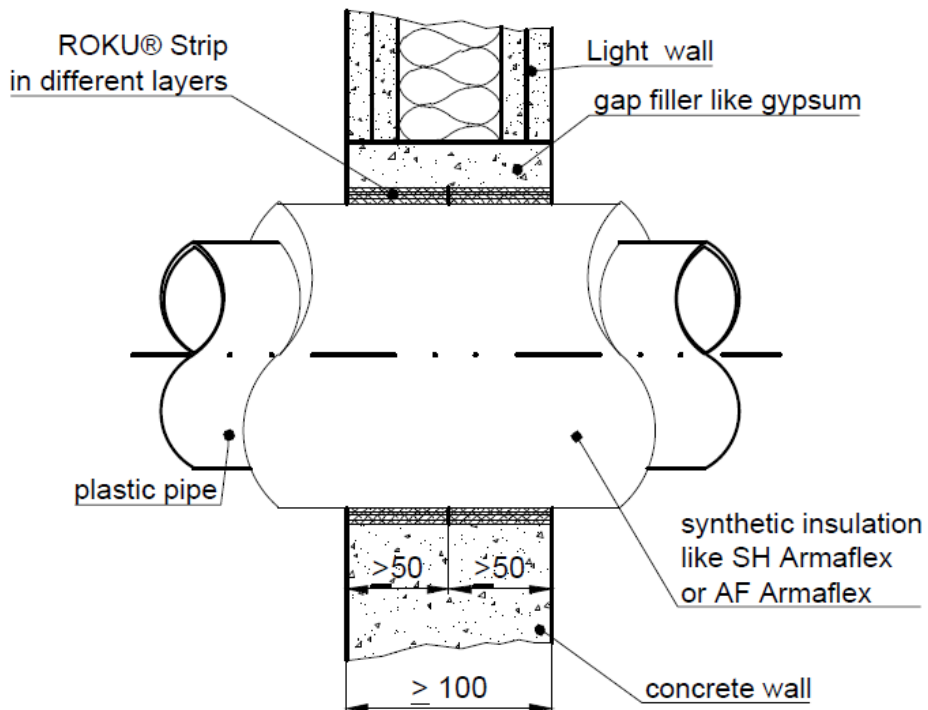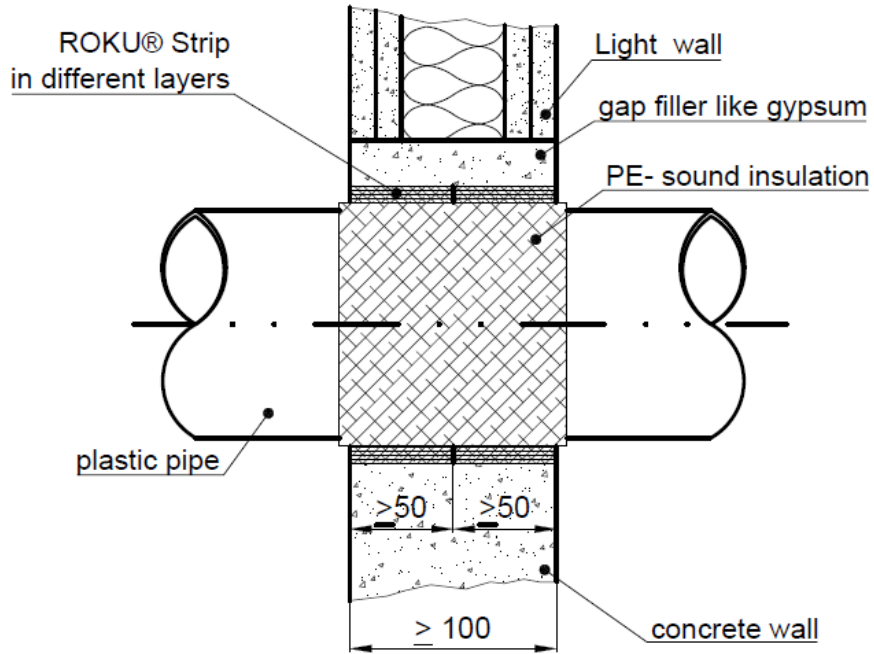

Installation in concrete floors with and without additional pipe insulation

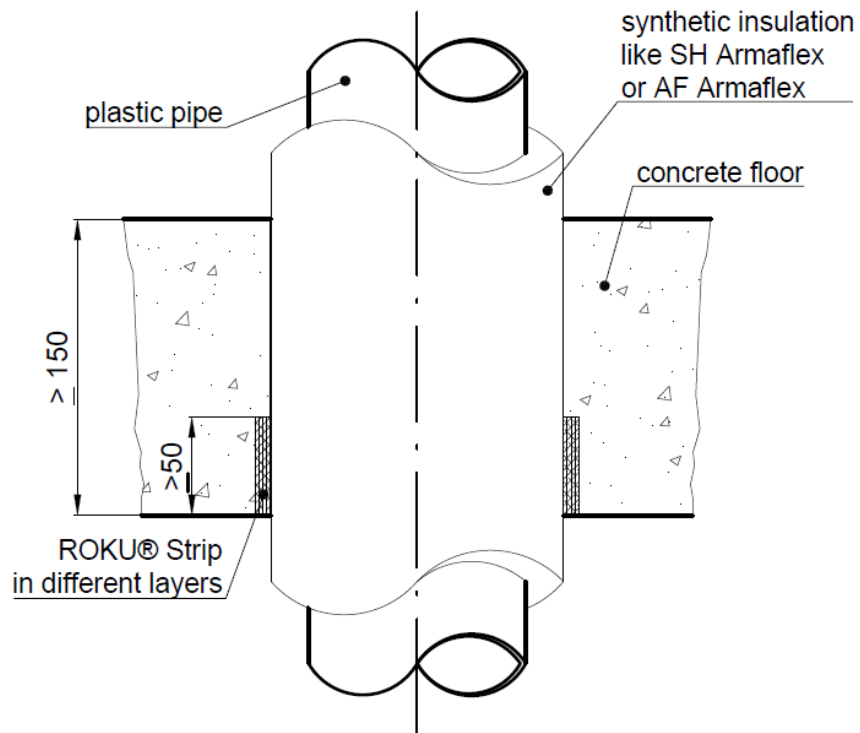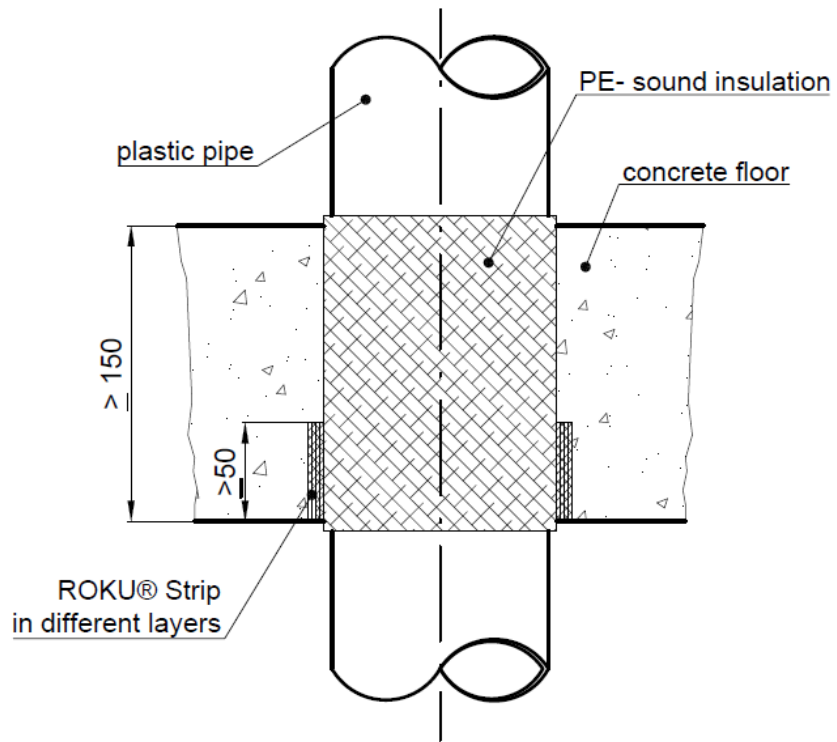

Installation in mineral wool sealants without additional pipe insulation

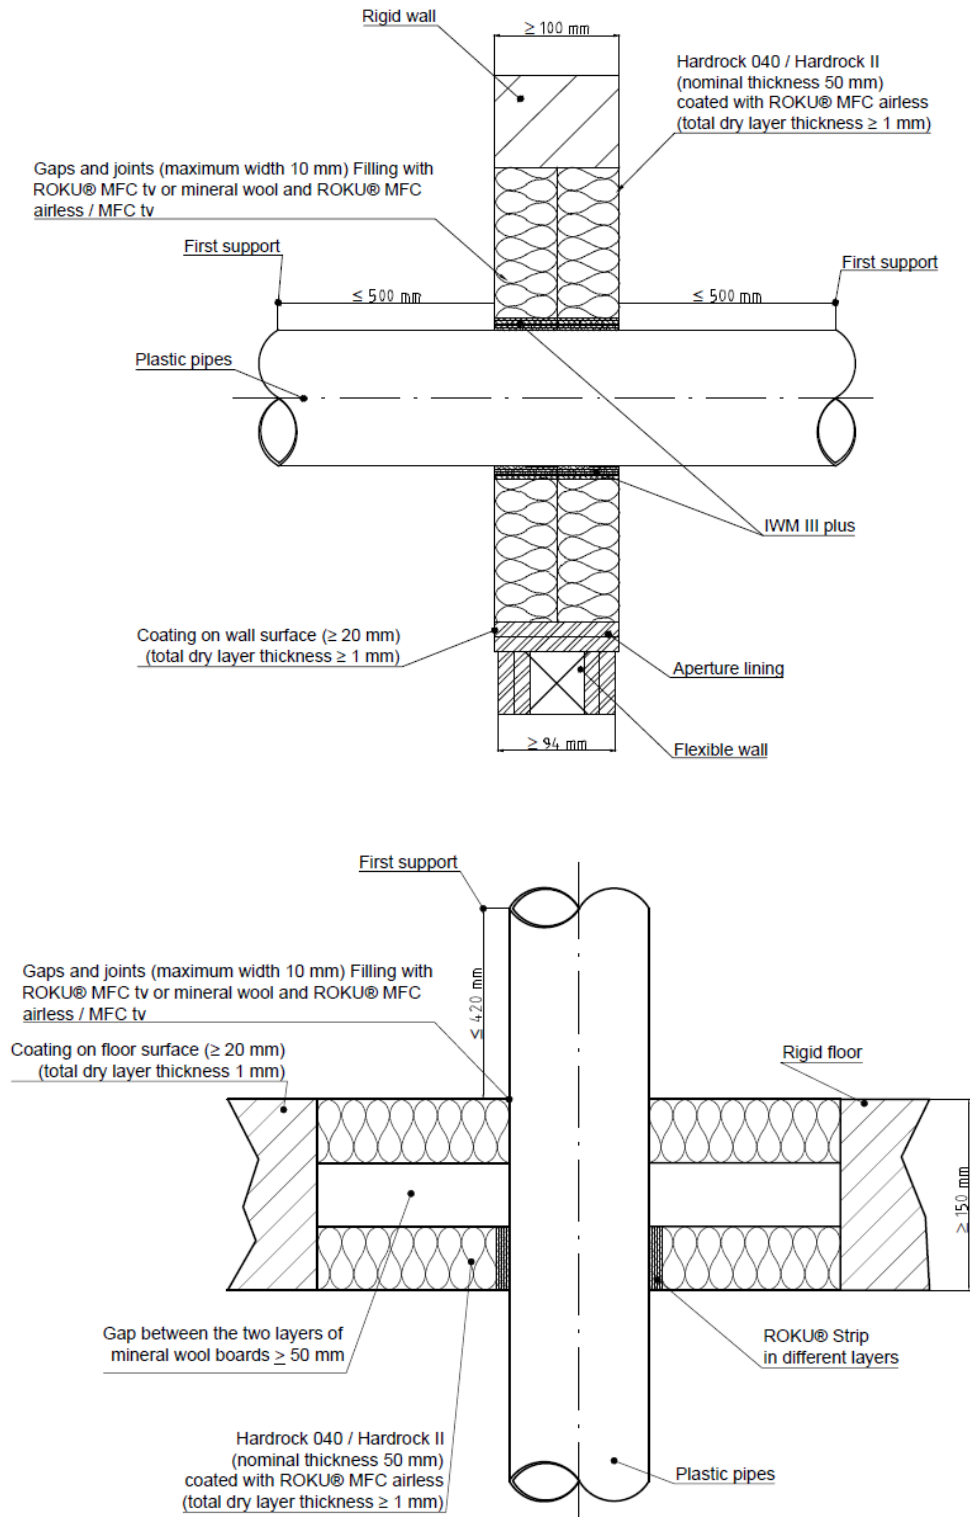



#### Annex 4

### Description of the installations for the confirmation of fire resistance in at least 100 mm walls

The below applies to seals in walls with the following specifications:

The wall must be classified according to EN 13501-2

The wall shall be at least 100 mm thick

The walls shall be made from concrete, aerated concrete, bricks or a lightweight partitions

For lightweight partitions, the number of boards on each side shall be at least 2 and the total thickness of the boards on each side shall be at least 25 mm

Lightweight partitions made with timber frame shall have at least two boards on each side, and the total thickness of the boards on each side shall be at least 25 mm. No penetration must be closer than 100 mm to a timber batten. The void between the penetration and the timber batten shall be filled with an insulation material with reaction to fire class A1 or A2 according to EN 13501-1

The pipes shall penetrate the walls perpendicular to the walls

The penetrations shall be made as single penetrations

The pipe insulation made from AF/Armaflex shall cover the pipes out to a distance of 350 mm from the surface of the wall on each side

The pipe insulation shall be continuous through the penetration.

The gap between the pipe and the wall shall be between 10 mm and 50 mm wide

The pipes may be covered with a PE foam based pipe insulation with a maximum thickness of 4 mm

Type of installation	Description
Pipes	<b>PVC-U pipes according to EN 1452-1</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation thickness ( mm )	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	1,8 - 5,6	2x2	without	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8 - 12,3	2x3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8 - 5,6	2x3	4 mm PE	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8- $\leq$ 2,2	2x4		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	2,2-12,3	2x3		EI 120 - U/C	E 120 - U/C
<b>Insulation synthetic rubber like AF Armaflex in the thickness groups AF 1 - AF 5</b>					
$\leq 50$	1,8-5,6	2x3	up to 9,5 mm	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	5,6-12,3	2x3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8-5,6	2x3	up to 31,5 mm	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-2,7	2x3	17- 18 mm	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-12,3	2x4	up to 31,5 mm	EI 120 - U/C	E 120 - U/C

Tolerances Armaflex AF: AF 1 – AF 2 + - 1,0 mm; AF 3 – AF 4 + - 1,5 mm; AF 5 + - 2,5 mm

Type of installation	Description
Pipes	<b>PE-HD pipes according to EN 1519-1</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	1,8	2x2	without	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	2x3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8	2x3	4 mm PE	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	2x3		EI 120 - U/C	E 120 - U/C
Insulation synthetic rubber like AF Armaflex in the tickness groups AF 1 - AF 5					
$\leq 50$	1,8	2x3	up to 9,5 mm	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	2x3		EI 120 - U/C	E 120 - U/C
$\leq 110$	1,8-10	2x4	up to 31,5 mm	EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>PP pipes according to EN ISO 15494</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. – Thermacompact TF ) Synthetic rubber like AF/Armaflex AF-1 to .. AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	1,8	2x2	without	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	2x3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8	2x2	4 mm PE	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	2x3		EI 120 - U/C	E 120 - U/C
Insulation synthetic rubber like AF Armaflex in the tickness groups AF 1 - AF 5					
$\leq 50$	1,8	2x3	up to 9,5 mm	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	1,8-10	2x3		EI 120 - U/C	E 120 - U/C
$\leq 110$	1,8-10	2x4	up to 31,5 mm	EI 120 - U/C	E 120 - U/C

Tolerances Armaflex AF: AF 1 – AF 2 + - 1,0 mm; AF 3 – AF 4 + - 1,5 mm, AF 5 + - 2,5 mm

Type of installation	Description
Pipes	<b>Wavin SiTECH pipes</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation (e.g. Thermacompact TF)</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	2,0	2x2	4 mm PE sound insulation like Thermacompact TF	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	2,0-2,55	2x3		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 90$	2,0-3,05	2x4		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	2,0-3,7	2x5		EI 120 - U/C	E 120 - U/C

According to EN 1366-3 section E.2.7.4 the following applies

The classification for PVC-U pipes according to EN 1453-1, EN 1329-1 or EN 1452-1, also applies to PVC-C pipes according to EN 1566-1

Classification for PE-HD pipes according to EN 1519-1 and EN 12666-1 also applies to PE pipes according to EN 12201-2, EN 1519-1 and EN 12666-1 and to ABS pipes according to EN 1455-1 and SAN+PVC pipes according to EN 1565-1

Type of installation	Description
Pipes	<b>Aquatherm green pipe MS ( old name : Fusiotherm Stabiverbund )</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 40$	5,6	2x2	without, with PE insulation or with synthetic rubber like AF Armaflex up to 31,5 mm	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 75$	5,6-10,4	2x3		EI 120 - U/C	E 120 - U/C
$> 40 - \leq 110$	10,4-15,2	2x4		EI 120 - U/C	E 120 - U/C



Type of installation	Description
Pipes	<b>Uponor MLC pipe white ( old name : Unipipe multilayer pipe )</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 40$	5,6	2x2	without, PE or synthetic rubber like Armaflex AF	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 75$	5,6-10,4	2x3	without	EI 90 - U/C	E 120 - U/C
		2x4		EI 120 - U/C	E 120 - U/C
		2x3	4 mm PE	EI 120 - U/C	E 120 - U/C
		2x3	up to 31,5 mm	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 110$	10,4- $\leq$ 15,2	2x4	without	EI 90 - U/C	E 120 - U/C
		2x5		EI 120 - U/C	E 120 - U/C
		2x4	4 mm PE	EI 120 - U/C	E 120 - U/C
		2x4	up to 31,5 mm	EI 120 - U/C	E 120 - U/C
120 mm wall thickness					
$> 40 - \leq 110$	10,4- $\leq$ 15,2	2x4	without	EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>Alpex Duo multilayer pipes</b>
Insulation (were stipulated in table)	<b>PE sound insulation or Armaflex AF thickness group AF 1 – AF 5</b>

The classification is declared under the following conditions:

Pipe $\varnothing$ (mm)	Wall thickness (mm)	Numbers of layers Roku strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 40$	3,5	2x2	without, PE or with synthetic rubber like Armaflex AF	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 75$	3,5-5,0	2x3	without	EI 120 - U/C	E 120 - U/C
		2x3	up to 9,5 mm	EI 90 - U/C	E 120 - U/C
		2x4	12,5 to 18 mm	EI 90 - U/C	E 120 - U/C
		2x4	25 to 31,5 mm	EI 120 - U/C	E 120 - U/C
		2x5	up to 31,5 mm	EI 120 - U/C	E 120 - U/C

### Annex 5

#### Description of the installations for the confirmation of fire resistance in 150 mm concrete slabs

The below applies to seals in 150 mm thick concrete slab

The below applies to seals in floors with the following specifications:

The floor must be classified according to EN 13501-2

The floor shall be at least 150 mm thick

The floor shall be made from concrete or aerated concrete with a density of at least 550 kg/m<sup>3</sup>

The distance between two single Ø110 mm penetrations shall be at least 100 mm

PVC pipes and multilayer pipes Unipipe, Alpex Duo and Fusiotherm Stabigverbund may be installed with less than 100 mm or zero relative distance in a linear distribution. In this case the requirements in the table regarding zero distance shall be observed.

The pipes shall penetrate the floor perpendicular to the floor

The pipe insulation made from AF/Armaflex shall cover the pipes out to a distance of 350 mm from the surface of the floor on each side

The pipe insulation shall be continuous through the penetration.

The gap between the pipe and the floor shall be between 10 mm and 50 mm wide, and shall be filled with an insulation material with reaction to fire class A1 or A2 according to EN 13501-1 or with cement or gypsum based mortar

The pipes may be covered with a PE foam based pipe insulation with a maximum thickness of 4 mm

Type of installation	Description
Pipes	<b>PVC-U pipes according to EN 1452-1</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness group AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe ø (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
≤ 50	1,8 - 5,6	2	without	EI 120 - U/C	E 120 - U/C
> 50 – ≤ 110	1,8 - 12,3	3		EI 120 - U/C	E 120 - U/C
50	3,7	2		EI 240 - U/C	E 240 - U/C
≤ 110	1,8 - 12,3	3	4 mm PE	EI 120 - U/C	E 120 - U/C
≤ 110	1,8-12,3	3	up 9,5 mm	EI 90 - U/C	E 90 - U/C
≤ 110	12,3	3	up to 18 mm	EI 90 - U/C	E 90 - U/C
≤ 110	1,8-<12,3	4	up to 23 mm	EI 90 - U/C	E 90 - U/C
110	12,3	4	15,5 - 23 mm	EI 120 - U/C	E 120 - U/C
≤ 110	1,8-<12,3	5	12,5 - 31,5 mm	EI 90 - U/C	E 90 - U/C
≤ 110	12,3	5		EI 120 - U/C	E 120 - U/C
≤ 160	4,7	6	without	EI 240 - U/C	E 240 U/C

Type of installation	Description
Pipes	<b>PE-HD pipes according to EN 1519-1</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness group AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	1,8	2	without	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8	3	4 mm PE	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8	3	up to 9,5 mm	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	1,8-1,9	3		EI 120 - U/C	E 120 - U/C
50	4,6	2	without	EI 240 - U/C	E 240 - U/C
$> 75 - \leq 110$	1,9-10	3	up to 9,5 mm	EI 90 - U/C	E 90 - U/C
110	10	3		EI 90 - U/C	E 120 - U/C
110	10	4		EI 90 - U/C	E 120 - U/C
110	10	3	9,5 - 18 mm	EI 120 - U/C	E 120 - U/C
$\leq 110$	1,8-10	4	9,5 - 31,5 mm	EI 120 - U/C	E 120 - U/C
110	6,3	4	without	EI 240 - U/C	E 240 - U/C

Type of installation	Description
Pipes	<b>PP pipes according to EN ISO 15494</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness groups AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	1,8	2	without	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8 - 10	3		EI 120 - U/C	E 120 - U/C
$\leq 50$	1,8	2	4 mm PE	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-10	3		EI 120 - U/C	E 120 - U/C
$\leq 110$	1,8-10	3	up to 9,5 mm	EI 120 - U/C	E 120 - U/C
$\leq 110$	1,8-10	4	up to 31,5 mm	EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>Wavin SiTECH pipes</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	2,0	2	4 mm PE sound insulation	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	2,0-2,55	3		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 90$	2,0-3,05	4		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	2,0-3,7	5		EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>POLO-KAL NG pipes</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	2,0	2	4 mm PE sound insulation	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	2,0-2,5	3		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 90$	2,0-2,9	4		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	2,0-3,4	5		EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>Geberit Silent PP pipes</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	2,0	2	4 mm PE sound insulation	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	2,0-2,5	3		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 90$	2,0-3,1	4		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	2,0-3,6	5		EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>Rehau Raupiano pipes</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF )</b>

The classification is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 50$	1,8	2	4 mm PE sound insulation	EI 120 - U/C	E 120 - U/C
$> 50 - \leq 75$	1,8-2,1	3		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 90$	1,8-2,4	4		EI 120 - U/C	E 120 - U/C
$> 50 - \leq 110$	1,8-2,7	5		EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>PVC pipes and multilayer pipes like Unipipe, Alpex Duo, Uponor MLC pipe white and Aquatherm green pipe MS (old name: Fusiotherm Stabiverbund) with zero relative distance</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness group AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification PVC Pipes is declared under the following conditions:

Pipe $\phi$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 110$	1,8-12,3	2	without / 4 mm PE / Armaflex AF up to 9,5 mm	EI 90 - U/C	E 90 - U/C
$\leq 110$	1,8 - 12,3	3	Armaflex AF 9,5 - 31,5 mm		

The classification of multilayer pipes is declared under the following conditions:

Maximum achieved classification	
E = Integrity and I = Insulation	E = Integrity
EI 90 - U/C	E 90 - U/C

Type of installation	Description
Pipes	<b>Aquatherm green pipe MS ( old name Fusiotherm Stabiverbund )</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness group AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\varnothing$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 40$	5,6	2	Without / PE / synthetic rubber like Armaflex AF	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 75$	5,6-10,4	3		EI 120 - U/C	E 120 - U/C
$> 40 - \leq 110$	10,4- $\leq$ 15,2	4		EI 120 - U/C	E 120 - U/C

Type of installation	Description
Pipes	<b>Uponor MLC pipe white ( old name: Unipipe multilayer pipe )</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness group AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\varnothing$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 40$	5,6	2	Without / PE / synthetic rubber like Armaflex AF	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 75$	5,6-10,4	3		EI 120 - U/C	E 120 - U/C
$> 40 - \leq 110$	10,4- $\leq$ 15,2	4		EI 120 - U/C	E 120 - U/C



Type of installation	Description
Pipes	<b>Alpex Duo multilayer pipes</b>
Insulation (were stipulated in table)	<b>4 mm PE sound insulation ( e.g. - Thermacompact TF ) Synthetic rubber like AF/Armaflex thickness group AF-1 to AF-5 (up to 31,5 mm thickness, tolerances + - 2,5 mm )</b>

The classification is declared under the following conditions:

Pipe $\varnothing$ (mm)	Wall thickness (mm)	Numbers of layers ROKU® Strip	Insulation	Maximum achieved classification	
				E = Integrity and I = Insulation	E = Integrity
$\leq 40$	3,5	2	without	EI 120 - U/C	E 120 - U/C
$> 40 - \leq 75$	3,5-5,0	3	without	EI 120 - U/C	E 120 - U/C
		3	4 mm PE	EI 90 - U/C	E 120 - U/C
		5		EI 120 - U/C	E 120 - U/C
		3	Armaflex AF up to 9,5 mm	EI 120 - U/C	E 120 - U/C
		4	Armaflex AF up to 31,5 mm	EI 120 - U/C	E 120 - U/C

## Annex 6

### Description of the installations for mineral fibre sealants in at least 100 mm walls

The below applies to seals in walls with the following specifications:

The wall must be classified according to EN 13501-2

The wall shall be at least 100 mm thick

The walls shall be made from concrete, aerated concrete, bricks or a lightweight partitions


For lightweight partitions, the number of boards on each side shall be at least 2 \* 12,5mm plasterboards according to EN520, the total thickness of the boards on each side shall be at least 25 mm.

For lightweight partitions the void between the boards shall be filled with 50 mm mineral wool with reaction to fire Euroclass A1 (100 kg/m<sup>3</sup>) according to EN 13501-1.

Lightweight partitions made with timber frame shall have at least two boards on each side, and the total thickness of the boards on each side shall be at least 25 mm. No penetration must be closer than 100 mm to a timber batten. The void between the penetration and the timber batten shall be filled with an 100mm insulation material with reaction to fire class A1 or A2 according to EN 13501-1

The Thickness of the mineral fibre sealant have to be at least 2 x 50 mm ( ROKU® System MFS according to the ETA -15/0014 )

The pipes shall penetrate the walls perpendicular to the walls

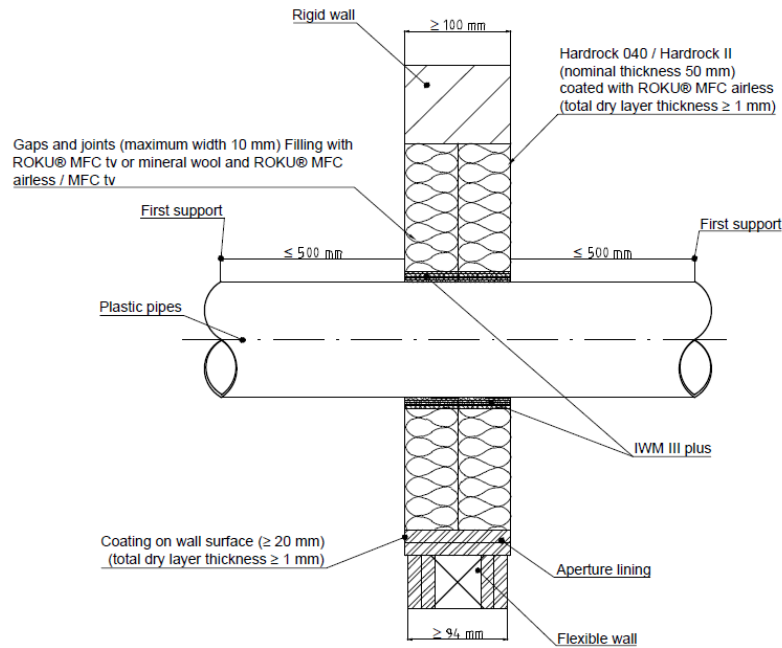

The classification is declared under the following conditions:

<b>The IWM III plus System wrapped around the following pipes in combination with the mineral fibre sealant ROKU® MFS in wall construction:</b>		
<b>Pipe type and number of layers of the wrap IWM III plus</b>	<b>E = Integrity and I = Insulation</b>	<b>E = Integrity</b>
PVC ø 50 x 2,4 mm – 2 layers	EI 120 U / U	E 120 U / U
PVC ø 75 x 3,6 mm – 3 layers	EI 120 U / U	E 120 U / U
PVC ø 110 x 5,3 mm – 4 layers	EI 120 U / U	E 120 U / U
PP ø 50 x 2,9 mm – 2 layers	EI 120 U / U	E 120 U / U
PP ø 75 x 4,3 mm – 3 layers	EI 120 U / U	E 120 U / U
PP ø 160 x 9,1 mm – 6 layers	EI 120 U / U	E 120 U / U

## Annex 7 Description of the installations for mineral fibre sealants in at least 150 mm concrete floors

The below applies to seals in 150 mm thick concrete floors ( $\geq 650 \text{ kg/m}^3$ )

The below applies to seals in floors with the following specifications:

The floor must be classified according to EN 13501-2


The floor shall be at least 150 mm thick

The floor shall be made from concrete or aerated concrete with a density of at least  $650 \text{ kg/m}^3$

The pipes shall penetrate the floor perpendicular to the floor

The Thickness of the mineral fibre sealant have to be at least  $2 \times 50 \text{ mm}$  ( ROKU® System MFS according to the ETA – 15/0014 )

The classification is declared under the following conditions:

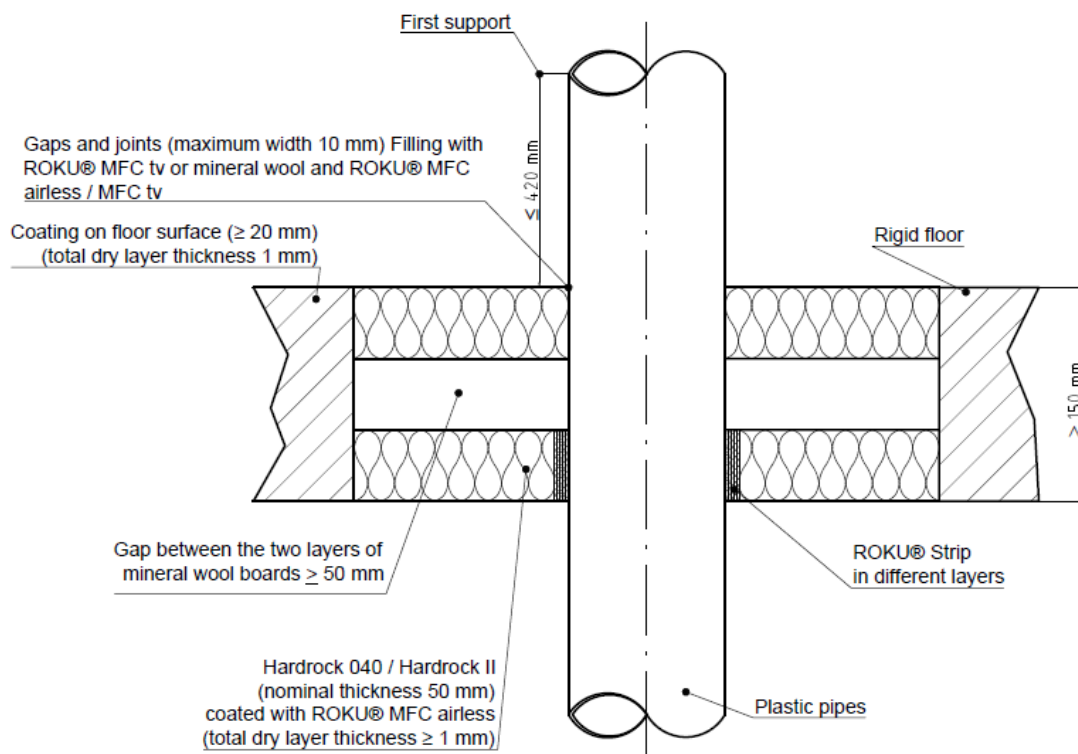

The classification is declared under the following conditions:

<b>The IWM III plus System wrapped around the following pipes in combination with the mineral fibre sealant ROKU® MFS in floor construction:</b>		
<b>Pipe type and number of layers of the wrap IWM III plus</b>	<b>E = Integrity and I = Insulation</b>	<b>E = Integrity</b>
PVC $\varnothing 50 \times 2,4 \text{ mm}$ – 2 layers	EI 60 U / U	E 120 U / U
PVC $\varnothing 75 \times 3,6 \text{ mm}$ – 3 layers	EI 120 U / U	E 120 U / U
PVC $\varnothing 110 \times 5,3 \text{ mm}$ – 4 layers	EI 90 U / U	E 120 U / U
PVC $\varnothing 160 \times 7,7 \text{ mm}$ – 6 layers	EI 90 U / U	E 120 U / U
PP $\varnothing 50 \times 2,9 \text{ mm}$ – 2 layers	EI 60 U / U	E 120 U / U
PP $\varnothing 75 \times 4,3 \text{ mm}$ – 3 layers	EI 120 U / U	E 120 U / U
PP $\varnothing 110 \times 6,3 \text{ mm}$ – 4 layers	EI 90 U / U	E 120 U / U
PP $\varnothing 160 \times 9,1 \text{ mm}$ – 6 layers	EI 120 U / U	E 120 U / U

### Annex 8

#### Description of the installations for the confirmation of fire resistance in shaft walls of $\geq 2 \times 20$ mm thickness

The below applies to seals in walls with the following specifications:

The shaft wall must be classified according to EN 13501-2

The shaft wall shall be at least  $2 \times 20$  mm thickness

For the divided shaft wall the number of boards shall be at least  $2 * 20$  mm plasterboards according to EN15283, the total thickness of the boards shall be at least 40 mm.

For the shaft wall the CW50 profiles shall be mounted with max. c/c 1000mm distance.


The pipe penetration distance to the nearest mounting must be max. 300 mm

The pipe penetration to other cables etc. must be min. 100 mm

The pipes shall penetrate the walls perpendicular to the walls

The pipe wrap will be only in the middle of the shaft wall

The shaft wall was tested from both sides during the official test in the test laboratory.

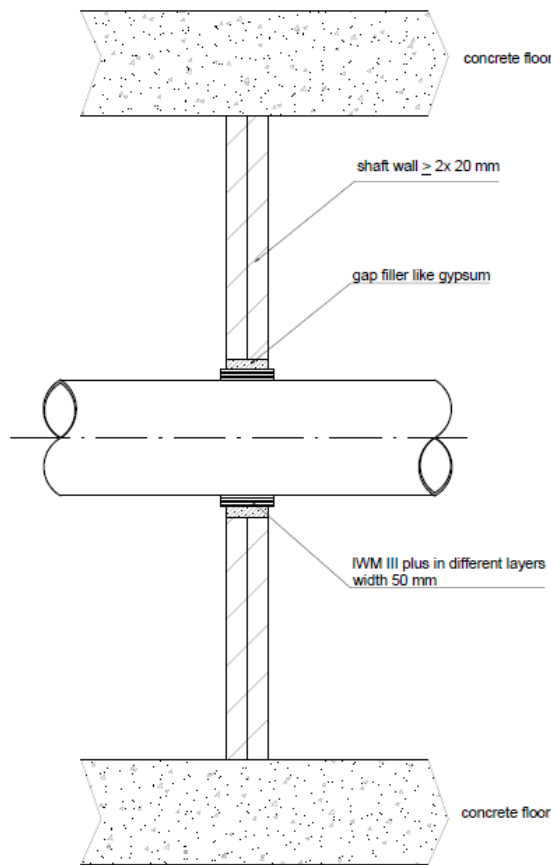

The classification is declared under the following conditions:

Pipe type and number of layers of the wrap IWM III plus	E = Integrity and I = Insulation	E = Integrity
PE $\varnothing$ 110 x 6,3 mm – 4 layers	EI 90 U / C	E 90 U / C
PP $\varnothing$ 110 x 6,3 mm – 4 layers	EI 90 U / C	E 90 U / C
PVC $\varnothing$ 110 x 5,3 mm – 4 layers	EI 90 U / C	E 90 U / C
PE $\varnothing$ 50 x 4,6 mm – 2 layers	EI 90 U / U	E 90 U / U
PP $\varnothing$ 50 x 4,6 mm – 2 layers	EI 90 U / U	E 90 U / U
PVC $\varnothing$ 50 x 3,7 mm – 2 layers	EI 90 U / U	E 90 U / U

### Annex 9

#### Description of the installations for the confirmation of fire resistance in shaft walls of $\geq 2 \times 20$ mm thickness with a doubling up of $2 \times 20$ mm

The below applies to seals in walls with the following specifications:

The shaft wall must be classified according to EN 13501-2

The shaft wall shall be at least  $2 \times 20$  mm thickness and a doubling up around the pipe of  $2 \times 20$  mm

For the divided shaft wall the number of boards shall be at least  $2 \times 20$  mm plasterboards according to EN15283, the total thickness of the boards shall be at least 40 mm.

For the shaft wall the CW50 profiles shall be mounted with max. c/c 1000mm distance.


The pipe penetration distance to the nearest mounting must be max. 300 mm

The pipe penetration to other cables etc. must be min. 100 mm

The pipes shall penetrate the walls perpendicular to the walls

The pipe wrap will be only in the middle of the shaft wall

The shaft wall was tested from both sides during the official test in the test laboratory.

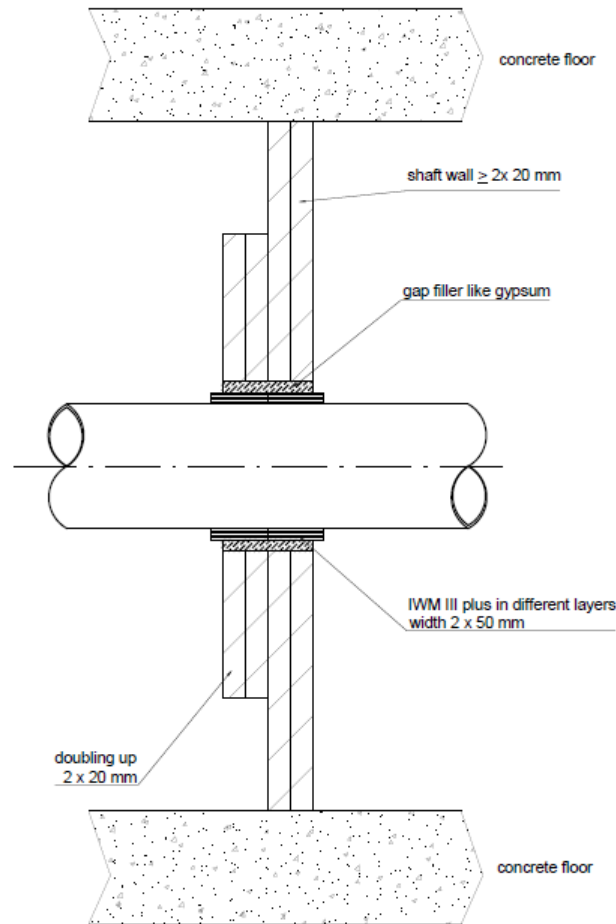

The classification is declared under the following conditions:

Pipe type and number of layers of the wrap IWM III plus	E = Integrity and I = Insulation	E = Integrity
PE $\varnothing$ 110 x 6,3 mm – 4 layers	EI 120 U / C	E 120 U / C
PP $\varnothing$ 110 x 6,3 mm – 4 layers	EI 120 U / C	E 120 U / C
PVC $\varnothing$ 110 x 5,3 mm – 4 layers	EI 120 U / C	E 120 U / C